



CLEANOUT PIPE SIZE SHALL CONFORM TO SEWER MAIN PIPE SIZE UP TO 12" I.D. PIPE - FOR SEWER MAINS OVER 12" I.D. A 12" CLEANOUT SHALL BE USED - A MANUFACTURED PIPE ADAPTOR SHALL BE USED WHEN CHANGING PIPE SIZE

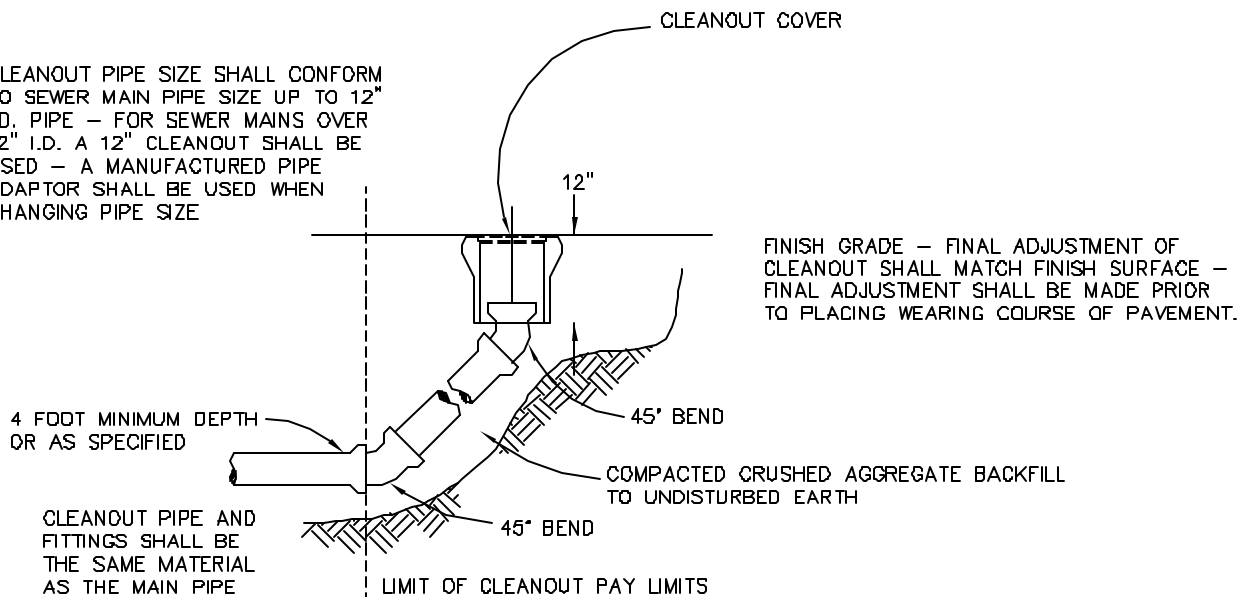

STANDARD CLEANOUT DETAIL

(FOR END OF SANITARY MAIN WITH FOUR OR LESS SERVICE CONNECTIONS)

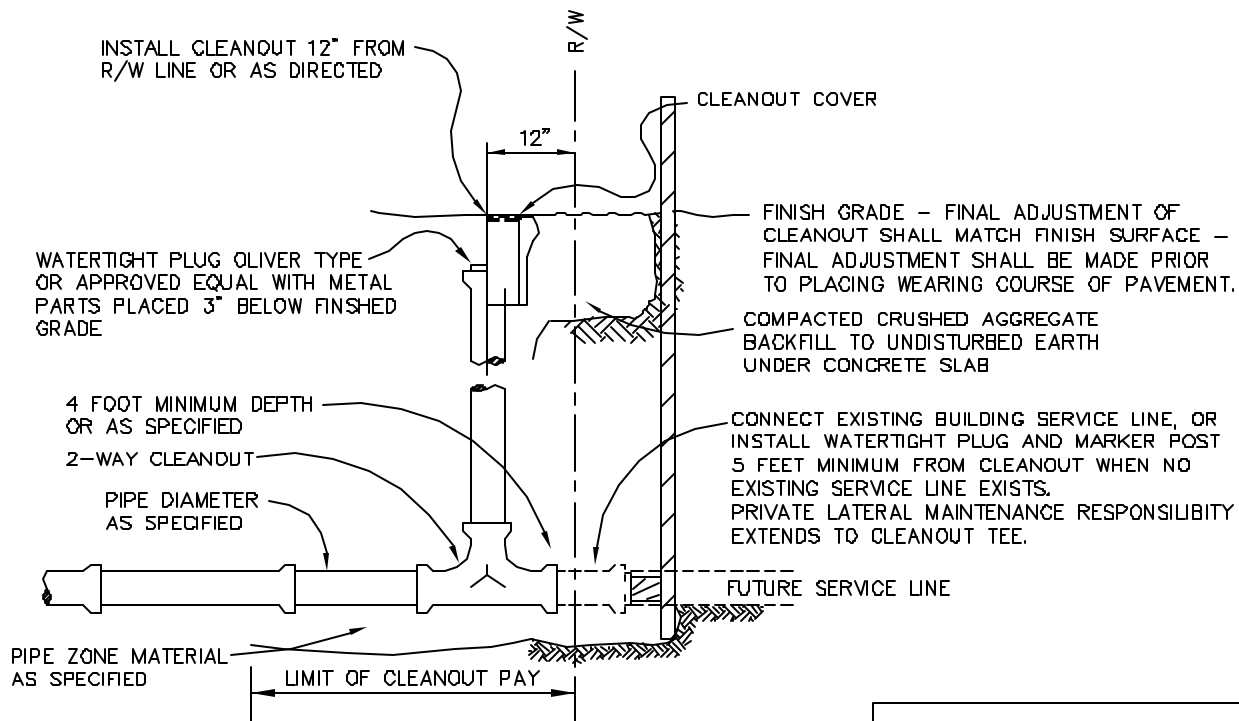

STANDARD SERVICE LATERAL CLEANOUT DETAIL

NOTES:

- 1) SEE DETAIL 206A FOR STANDARD MAIN PIPE CONNECTION DETAILS.
- 2) MARKER POSTS AND BLOCKING FOR END OF LINE SHALL BE A PRESSURE TREATED 2x4. POST SHALL EXTEND 12" ABOVE FINISH GRADE AND PAINTED WHITE.
- 3) CLEANOUTS OUTSIDE OF PAVED AREA SHALL BE IDENTIFIED WITH FIBERGLASS MARKER POST.
- 4) GLUE-ON OR SOLVENT WELDED PLUGS SHALL NOT BE PERMITTED.
- 5) MIN. DEPTH AT RIGHT-OF-WAY LINE SHALL BE 4 FT. OR AS SPECIFIED.

CITY OF CORVALLIS

ENGINEERING DIVISION

STANDARD CLEANOUT

DATE: JULY, 2005

SCALE: NONE

STANDARD DETAIL No.

APPROVED: *EB*

206